



ROOTS BLOWER & VACUUM PUMP DIVISION


PERFORMANCE BASED ON INLET AIR AT

CONNERSVILLE, INDIANA 47331

68°F. & DISCHARGE PRESSURE = 30" HG. ABS.

PRINTED IN U.S.A.

APRIL 1970

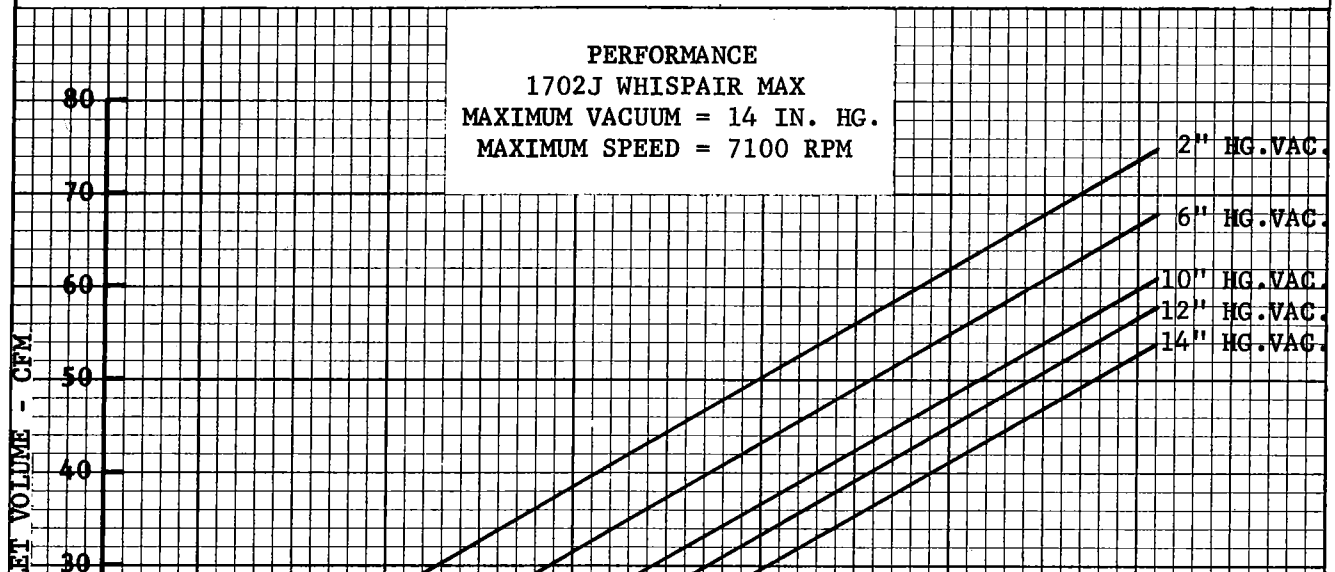

800-536-9933

www.pdblowers.com

